

**CONSTRUCTION STANDARD FOR
UNDERGROUND DISTRIBUTION NETWORK
PART 12: UNIT SUBSTATION + RMU
LAYOUT**

Issue Date: 08- 2019 **Page:** 1 of 3

SDCS-02-12 REV. 0

**SDCS-02-12
REV. 0**



**CONSTRUCTION STANDARD FOR UNDERGROUND
DISTRIBUTION NETWORK
PART 12: UNIT SUBSTATION + RMU LAYOUT**

This document contains proprietary information developed by and for exclusive use of Saudi Electricity Company (SEC) Distribution Network. Your acceptance of the document is an acknowledgment that it must be used for the identified purpose/application and during the period indicated. It cannot be used or copied for any other purposes nor released to others without prior written authorization of SEC Distribution Services Sector. SEC shall assume no responsibility for any type of misuse and/or misapplication, and any harm resulting there from. SEC also reserves the right to take any necessary actions to protect its interest against unauthorized use.


CONSTRUCTION STANDARD FOR UNDERGROUND DISTRIBUTION NETWORK PART 12: UNIT SUBSTATION + RMU LAYOUT

SDCS-02-12 REV.0

DATED: 2019-08

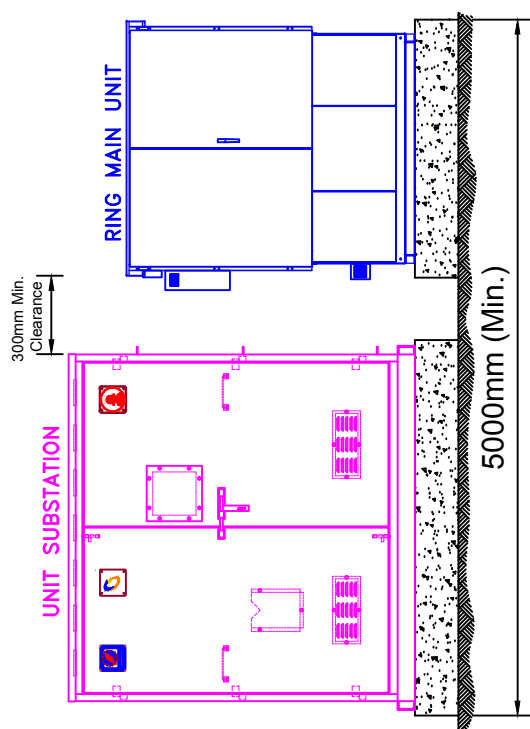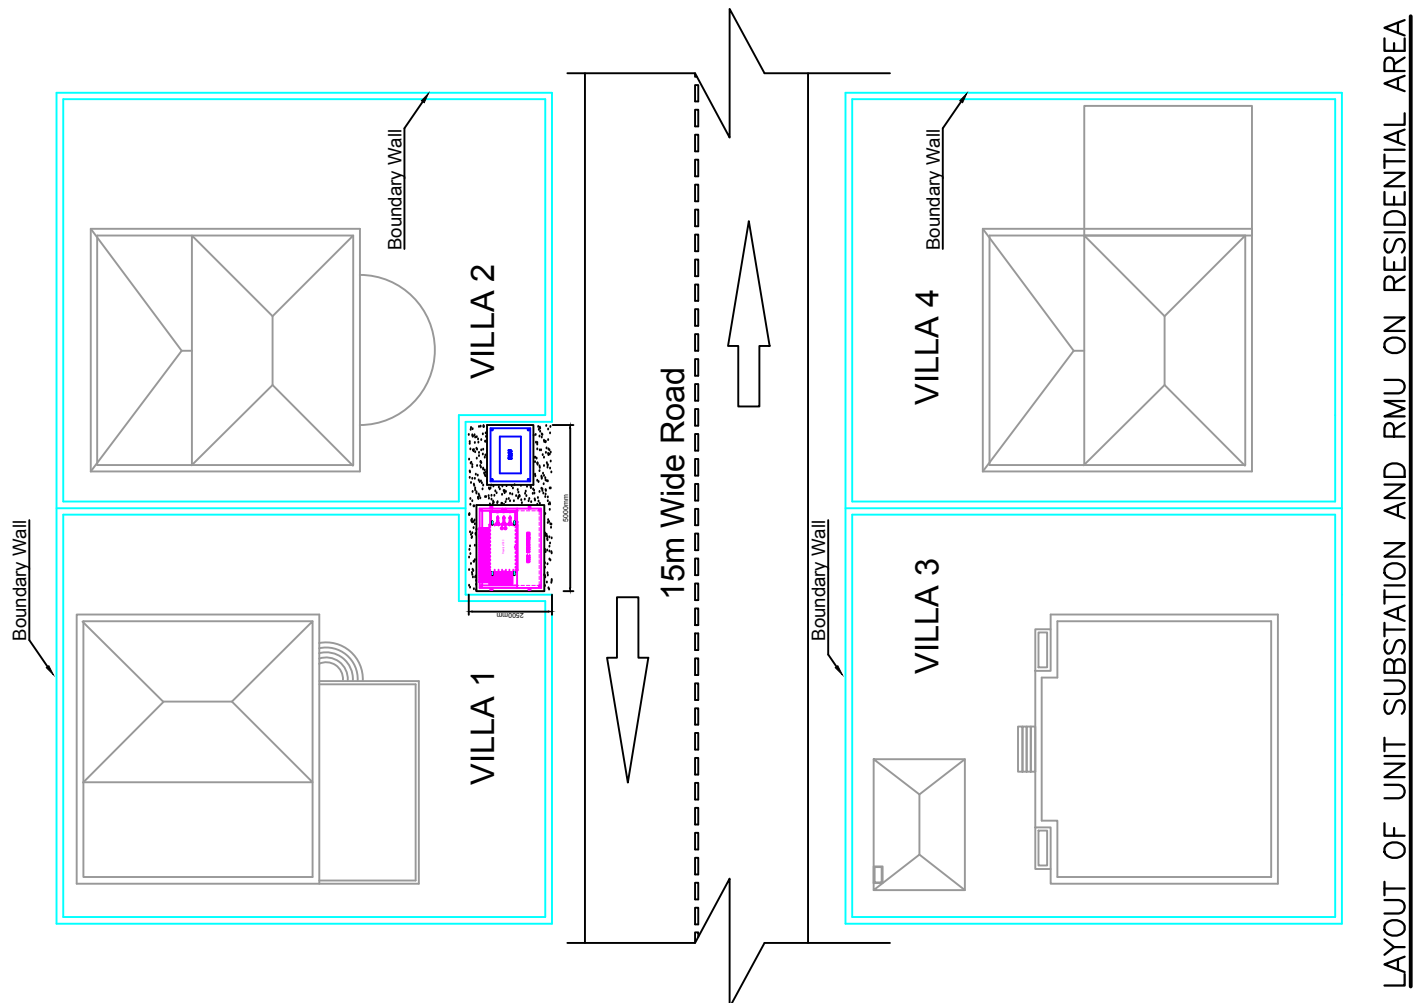

FRONT VIEW OF UNIT SUBSTATION AND RMU
ON SEPARATE CONCRETE FOUNDATION

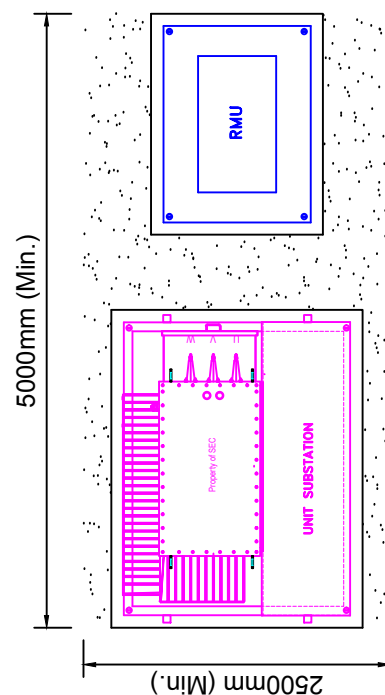

OVER ALL PLAN OF UNIT SUBSTATION
AND RMU

ALL DIMENSIONS ARE IN MILLIMETER

**CONSTRUCTION STANDARD FOR UNDERGROUND
DISTRIBUTION NETWORK
PART 12: UNIT SUBSTATION + RMU LAYOUT**

SDCS-02-12 REV.0

DATED: 2019-08

