

**Saudi Electricity Company**



**الشركة السعودية للكهرباء**

**SEC DISTRIBUTION MATERIALS SPECIFICATION**

**31-SDMS-07,Rev.01**

**DATE: MAY 2017G**

**31-SDMS-07**

**REV. 01**

**SPECIFICATIONS**

**FOR**

**LOW VOLTAGE  
DISTRIBUTION PANEL  
WITH ALUMINUM BUS BARS**

**This specification is property of SEC and  
subject to change or modification without any notice**



## CONTENTS

<u>Clauses:</u>	<u>Page No.</u>
1.0 SCOPE .....	3
2.0 CROSS REFERENCES .....	3
3.0 APPLICABLE CODES AND STANDARDS .....	3
4.0 DESIGN AND CONSTRUCTION REQUIREMENTS .....	4
4.1 General .....	4
4.2 Incoming Transformer Connections .....	5
4.3 Bus bars .....	5
4.4 Generator Connection .....	6
4.5 Neutral Busbar .....	6
4.6 Current Transformer .....	6
4.7 Ammeters and voltmeters .....	6
4.8 KWH-Meter Wiring Provision .....	6
4.9 Outgoing MCCB's .....	7
4.10 Grounding .....	9
4.11 Internal Lighting .....	9
4.12 Auxiliary Supply .....	9
4.13 LV Outgoing Cable Support .....	9
4.14 Labels ....	10
4.15 Enclosure .....	10
4.16 Dimensions .....	11
5.0 NAME PLATE .....	12
6.0 MONOGRAMS & DANGER PLATES .....	12
7.0 TESTING .....	12
7.1 Type (Design) Test ...	12
7.2 Routine Test .....	13
8.0 INSPECTION .....	13
9.0 PACKING AND SHIPPING .....	13
10.0 GUARANTEE .....	14
11.0 SUBMITTALS .....	14
12.0 DATA SCHEDULE .....	15

### LIST OF FIGURES-DRAWINGS

<u>Figure No.</u>	<u>Description</u>	
1.	Figure 1. Front view of Door .....	18
2.	Figure 2 Door Details and side view .....	19
3.	Figure 3 Indoor LVDP .....	20
4.	Figure 4 Panel internal Layout .....	21
5.	Figure 5 Plan view of gland plate .....	22
6.	Figure 6 Handle for two Interconnected Breakers .....	23
7.	Figure 7 Wooden Cables Clamps .....	24
8.	Figure 8 Circuit Labels .....	25



## SCOPE

This SEC Distribution Material Specification (SDMS) specifies the minimum technical requirements for design, materials, manufacturing, testing, inspection and performance for low voltage distribution panels with Aluminum busbars, to be used in the distribution network of the Saudi Electricity Company (SEC) in Saudi Arabia.

### **1.0 CROSS REFERENCES**

This material standard specification shall be read in conjunction with SEC specification No. 01-SDMS-01(latest revision), titled “General Requirements For All Equipment/Materials” which shall be considered as an integral part of this SDMS, also be read in conjunction with SEC purchase order (P.O.) requirements or contract schedules.

### **2.0 APPLICABLE CODES AND STANDARDS:**

The latest revision of the following codes and standards shall be applicable for the equipment/materials covered in this specification. In case of any deviation, the vendor/manufacturer may propose equipment/material conforming to an alternate code or standard without jeopardizing the requirements of this SDMS. However, the provision of SEC standard shall supersede the provision of these standards in case of any differences.

- |     |             |  |
|-----|-------------|--|
| 2.1 | 11-SDMS-01  | 1000V XLPE Insulated Unarmored Power Cables.   |
| 2.2 | 37-SDMS-02  | Low Voltage Molded Case Circuit Breakers For low voltage distribution panels 400 Amps. |
| 2.3 | IEC 60529   | Degrees of Protection Provided by Enclosures (IP Code).                                |
| 2.4 | 50-SDMS-01  | Current Transformers up to 36 KV.  |
| 2.5 | 38-SDMS-03  | LV Digital Panel Meters.   |
| 2.6 | IEC 60947-1 | Low Voltage Switchgear and Control gear Part-1 General Rules                           |
| 2.7 | IEC 60947-2 | Low Voltage Switchgear and Control gear Part-2 Circuit Breakers                        |
| 2.8 | IEC 61439-1 | Low Voltage Switchgear and Control gear assemblies. Part-1 General Rules.              |
| 2.9 | IEC 61439-6 | Low Voltage Switchgear and Control gear assemblies. Part-6 Bus bar                     |



trunking systems (busways).

- 2.10 IEC 60114 Recommendations for Heat-Treated Aluminum Busbar material of the Aluminum-Magnesium-Silicon Type.
- 2.11 ASTM B236M Standard Specification for Aluminum Bars for Electrical Purposes (Bus bars) Metric.
- 2.12 ASTM D1535 Standard Practice for Specifying Color by the Munsell System.
- 2.13 ASTM B117 Standard Practice for Operating Salt Spray (Fog) Apparatus.
- 2.14 ASTM D3359 Standard Test Methods for Measuring Adhesion by Tape Test.
- 2.15 ASTM A153 Standard Specification for Zinc Coating (hot-dip) on Iron and Steel Hardware.
- 2.16 ASTM B317 Standard Specification for Aluminum Bars for Electrical Purposes (Bus bars).
- 2.17 ASTM B 221 Standard Specification for Aluminum alloy extruded bus.

### 3.0 DESIGN AND CONSTRUCTION REQUIREMENTS

#### 3.1 General

- 3.1.1 The panel shall be supplied in two types for indoors and outdoors use, which contains incoming transformer connections, Aluminum bus bars, instruments panel, 400A molded case circuit breakers (MCCB) for out-going circuits, neutral bus bar, earthing terminals, and the provision for generator connections.
- 3.1.2 All cable terminations shall be easily accessible from the front.
- 3.1.3 All insulating materials shall be non-hygroscopic and resistant to tracking and cracking.
- 3.1.4 Panel completes with all its fittings and attachments shall be capable of withstanding the effects of direct solar radiation at their installed locations. The temperature of metal surfaces exposed to direct solar radiation shall be regarded as 75° C, plus the effect of any internal heating.
- 3.1.5 Thermal inter-action shall not unduly affect the performance of any components.



3.1.6 All parts of equal size and shape shall be interchangeable. The general design shall be made with minimum number of joints.

3.1.7 All connections inside the panel shall have a minimum clearance which shall not be less than 25.4 mm between phase and ground as per NEMA standards. In case the above clearance cannot be obtained, adequate insulating material shall be provided.

All bolts & nuts shall be installed in a way that they could not be unbolted from outside the panel. Extra length of fasteners shall be avoided.

### 3.2 Incoming Transformer Connections:

3.2.1 For unit and package substations, incoming transformer connections shall be through L.V. bus bars. Removable **Aluminum** links shall be provided to enable the disconnection of incoming transformer bus bar connection from L.V. bus bar.

3.2.2 For stand-alone L.V. Panels they shall permit the use of single core copper cable of the size 630mm<sup>2</sup> with compression lugs as shown in Figure (2) of SEC specification No. 12-SDMS-02. These lugs will be supplied by SEC. M10x70mm bolts with nuts and washers shall be provided. Number of incoming cables shall be as specified as in Table-1 of this specification.

### 3.3 Busbars:

3.3.1 The Bus bars shall be high conductivity Aluminum alloy. The bus bars shall be tin coated and uniform cross section as per ASTM B221 or approved equivalent.

3.3.2 The cross sectional area of bus bars shall be as per Table-1 of this specification.

3.3.3 All bolted electrical joints shall be secured by corrosion proof steel fasteners. All bolts, nuts, washers and studs shall be galvanized and comply with SEC specification No. 01-SDMS-01.

3.3.4 Two insulating steel cover plates, each equipped with a window, which shall be UV resistant, unbreakable, transparent, minimum 3 mm thick, heat resistant, non-hygroscopic and polycarbonate door. The cover shall be casketed /hinged and fitted with locking bar to secure them at the center. Stain less steel hinges shall be welded Hinges shall be fitted by bolts made from stainless steel or brass.

3.3.5 Adequate removable and insulating barrier between the operator and the live bus bars shall be provided.



- 3.3.6 Phase bus bars shall be sequence marked in color from front to back red, yellow, blue and neutral bus bar shall be marked black. The marking shall be done by indelible paint at both ends and the middles of the bus bars.
- 3.3.7 Bus bars shall be spaced and staggered in such a way that installation of MCCBs and associated cables can be achieved without any difficulty using common tool.
- 3.3.8 Phase bus bars shall have the provision to accommodate SEC approved CTs as per SEC specification No. 50-SDMS-01 (latest revision) for the ratios given in table .
- 3.3.9 The bus bar links for branch MCCBs shall be provided with insulated colored sleeves (red yellow and blue).

#### 3.4 **Generator Connection:**

Holes of 13mm diameter for installation of mobile generator shall be provided. The distance between each two holes shall be 50mm center to center.  
The holes shall be suitable for lugs provided by SEC, two (2) for L.V. Panel up to 1600A rating and four (4) for L.V. Panel exceeding 1600A.

#### 3.5 **Neutral Busbar:**

The size of neutral bus bar shall be as per Table-1 of this specification. It shall be connected to the frame by insulated bolts, easily removable link. Holes of 13mm diameter shall be provided for each outgoing cable connection (lug type).

#### 3.6 **Current Transformer:**

Three Current Transformers conforming to SEC specification No. 50-SDMS-01 shall be installed at the incoming bus bars of the distribution panel for metering purpose. CTs secondary neutral terminals shall be earthed. The current rating is indicated in Table-1 of this specification, Insulation Class-E and 120°C

#### 3.7 **Ammeters And Voltmeters:**

L.V. panel shall be equipped with a digital panel meter according to SEC specification No. 38-SDMS-03 latest revision and supplied from SEC approved manufacture, CT ratio shall be pre programmed by panel manufacturer .

#### 3.8 **KWH-Meter Wiring Provision:**

All wiring shall be 2.5 mm<sup>2</sup> copper conductor and black PVC. Connectors shall be full ring insulated crimp type. CT short circuit links shall be provided on terminal block.



KWH-Meter wiring shall be made directly without Fuses. Dual wired terminal block for connection of a 3-phase 4-wire CT KWH-Meter shall be provided inside the metering panel.

3.9 **Outgoing MCCBs:**

3.9.1 Provision for installation of 400A MCCBs according to SEC specification No. 37-SDMS-02 latest revision shall be already made for each outgoing feeder and also suitable for installing at least three (3) SEC approved MCCBs.

Unless otherwise specified in the tender, number of MCCBs supplied/installed in the L.V. Panel shall be  $(n - 2)$  where n is the no. of outgoing MCCBs in Table-1. However minimum number shall be 2.

3.9.2 MCCB outgoing terminals shall be suitable for direct connection of 300mm<sup>2</sup> Al. cable as per SEC specification No. 11-SDMS-01 by means of bimetallic lugs with M10 bolt and palm width of 30mm. as per Figure No. 5 of SEC specification No.12-SDMS-02

3.9.3 One Mechanical Link to connect two nearby MCCBs in parallel shall be provided with each panel. It shall be as per attached drawing in page No. 23

3.9.4 These MCCBs shall comply with the following:

- (A) Easily interchangeable with at least 3 SEC approved manufacturers, if possible.
- (B) Without lock and without terminal spreaders.
- (C) With current limiting functions.



**Table (1)**  
**Low Voltage Distribution Panel**

Components	TRANSFORMER RATING							
	300 kVA		500 kVA		1000 kVA		1500 kVA	
	230/133V	400/230 V	230/133V	400/230 V	230/133V	400/230 V	230/133V	400/230 V
L.V. Panel incoming bus bar/link rating (A) minimum	800	500	1600	800	3000	1600	4000	2500
CT rating on incoming bus bars (A)	800/5	800/5	1500/5	800/5	3000/5	1500/5	4000/5	3000/5
Incoming cables for standalone L.V panel	2/ph 1/N	2/ph 1/N	2/ph 1/N	2/ph 1/N	4/ph 2/N	2/ph 1/N	6/ph 3/N	4/ph 2/N
For L.V. panel used in unit/package substations	Incoming connection shall be through removable Aluminum bus bar links from back of the panel							
Number of Outgoing MCCB's	4	2	8	4	12	8	14	10
Minimum Spacing MCCB's	Not less than 10mm							
Phase Bus bars min. cross section (mm <sup>2</sup> )	1x10x80	1x10x50	2x10x80	1x10x80	3x10x100	2x10x80	3x15x100	2x15x100
Phase Bus bars min. Rating, (A)	800	500	1600	800	3000	1600	4000	2500
Neutral Bus bar min. Size (mm <sup>2</sup> )	1x5x80	1x5x50	1x10x80	1x5x80	2x10x100	1x10x80	2x15x100	1x15x100
Neutral Bus bar min. Rating, (A)	400	250	800	400	1600	1000	2500	1600
Ammeter Scale	As per specification No. 38-SDMS-03 latest edition							
Voltmeter Scale								
Symmetrical Short Circuit Rating for 2 sec. (RMS), kA	25	25	25	25	40	25	65	40

**Notes:**

- A) The above table is applicable for all ratings of Unit & Package substations.
- B) The Stand-alone L.V panel designs shall be rated by current as indicated in the table as:
- (I) 1600A L.V. panel to be used for 500kVA (230/133V) and 1000kVA (400/230V) transformer ratings,
  - (II) 3000A L.V. panel to be used for 1000kVA (230/133V), 1500kVA (400/230V) transformer ratings,
  - (III) 4000 A LV Panel to be used for 1500 kVA (230/133V) transformer rating.
  - (IV) System voltage measurement shall be provided in the metering panel to ensure the voltage rating for LV panels rated 230/133 V and to be used for 400/230V in future. LV Panels designed to be used in Unit substation dual LV Transformers shall be designed for LV ratings of 230/133 V.





(V) The rating of main breaker in LVDPs with main breaker shall be according to bus bar rating.

#### 4.10 Grounding:

4.10.1 Two terminals having M12 stud with nuts and washers made of stainless steel shall be provided on enclosure of the panel with clear identified grounding mark.

4.10.2 Two nos. removable links between neutral bus bar and panel body with 70<sup>2</sup> mm bare copper conductor shall be provided.

4.10.3 All hinged parts shall be connected to the frame work (enclosure) through minimum 35mm<sup>2</sup> bolted copper braids for main doors and 16 mm<sup>2</sup> for sub panels.

#### 4.11 Internal Lighting:

The L.V. Panel shall be fitted with a 100 Watt lamp controlled by the door's operated switch. The auxiliary circuit supplying the lamp shall have a separate miniature circuit breaker located at an accessible position on the metering panel.

#### 4.12 Auxiliary Supply:

4.12.1 A pre-wired terminal block for 3 phases, 4-wire connections shall be installed inside the metering panel. The terminals size shall be suitable for 10mm<sup>2</sup> standard wiring. 10A miniature circuit breakers shall be provided in the circuit.

4.12.2 The L.V. Panel shall be equipped with a 230V three pin socket outlet on the metering panel, completed with plug top and labeled with the appropriate voltage. The position of the socket outlet shall not impede cable installation or termination.

Wiring shall be done by 4mm<sup>2</sup> copper, 85°C black PVC insulation with crimping type connectors.

#### 4.13 L.V. Outgoing Cable Support:

4.13.1 Cable support wooden / pre-molded clamps shall be provided and fixed above L.V. Panel's base frame just below cable break-out position. They shall be adequate to support the cable in normal service and when subjected to short circuit tests per attached drawing in page No. 22 and 24.

L.V. Panel's base frame cover shall be fabricated in two half plate, each plate is divided into three sections for easy installation and removal of outgoing cables. Sealable cable entry holes shall be provided.



4.13.2 Adequate vertical clearance of 500mm for phases, 400mm for neutral above cable clamps and horizontal spacing shall be provided to permit connection of the phase conductors on MCCB terminals, irrespective of their formation.

All L.V. Cables shall be terminated from front in a horizontal plane at one level and clamped inside L.V. Panel.

4.13.3 Access to the L.V. Cables Termination shall be made from the front by means of gasketed/hinged doors fitted with locking bar to secure them at the center. Hinges shall be fitted by bolts made from stainless steel or brass.

#### 4.14 Labels:

4.14.1 Each outgoing circuit shall be provided with three layers traffolite label plate (white/black/white) of 3mm thickness, dimension of 30mm x 80mm, bolted and blank (non-numbered)

4.14.2 These label plates shall be fixed above the MCCB in suitable place.

4.14.3 The outgoing cable feeder no. plate of steel sheet size at least A4 shall be provided. The printed table on the left door inner side shall also be acceptable.

#### 4.15 Enclosure:

The enclosure shall be designed as follows:

4.15.1 Weather proof and provided with watershed top. Enclosure shall be made of galvanized steel sheet at least 3mm thickness or Aluzinc at least 2 mm thickness.

4.15.2 Adequate ventilation shall be provided by means of canopy, louvers....etc. to allow natural circulation of air. Ventilation shall be suitable screened to prevent the entry of insects and foreign bodies. Screen material shall be made of strong enough stainless steel. Degree of protection shall be IP 53, and IP 41 of IEC 60529 for Outdoor and Indoor applications respectively.

4.15.3 For stand-alone L.V. Panels, enclosure shall be suitable for mounting on a flat base at ground level. Holes shall be provided for fixing M16 size foundation bolts.

4.15.4 Access to the L.V. outdoor panel shall from front by means of doors with gasket and steel hinges duly welded, and pad locking arrangement shall be through stainless steel hasp assembly as shown in Figure 1 and Figure 2 and as mentioned below.

i) Doors shall be fitted through three stainless steel welded hinges.



## SEC DISTRIBUTION MATERIALS SPECIFICATION

31-SDMS-07 REV. 01

DATE: MAY 2017G

- ii) Pressure fit type gasket shall be provided. Glue fit type is not acceptable.
- 4.15.5 All doors shall be provided with door stoppers and locking at open position to protect them from swinging in order to avoid accidents.
- 4.15.6 The panel shall be fitted with lifting lugs on both side at the top, and located such that the unit is balanced when lifted.
- 4.15.7 Insertion Pocket for circuit number plate , any instruction manuals and wiring circuit diagram shall be provided in the left side of the panel's door.
- 4.15.8 Finishing Color:  
The enclosure shall be adequately protected against corrosion and painted and the color shall be RAL 7035 or as per SEC specification No. 01-SDMS-01

4.15 **Dimensions:**

Maximum overall dimensions for stand-alone L.V. Panel shall be as follows:

Source Rating	Length (mm)	Width (mm)	Height (mm)
1600 A	1800	650	1900
3000 A	2000	650	1900
4000 A	2500	650	1900

5 **NAME PLATE:**

Each panel shall be provided with an aluminum name plate fixed inside on left door bearing the following information engraved on it with minimum in Arabic and in English:

- Reference to SEC specification
- Rated voltage (V)
- Rated current of bus bar (A)
- Rated current of incoming unit (A).
- Rated current of outgoing unit (A).
- Short circuit current rating (kA)
- CT Ratio installed.
- Bus Bar Material : Aluminum
- SEC purchase order number
- SEC item number
- Manufacturer's / Vendor's name
- Year of manufacture
- Gross weight when fully equipped (kg)
- Serial number



## 6 MONOGRAM & DANGER PLATES:

Danger plate and SEC monogram as per SEC drawings No. SEC-01-01 and SEC-01-02 respectively shall be provided and installed at the front (on SEC approved location) of the L.V. Panel using M5 hot dipped galvanized/stainless steel/brass fasteners (oval head rounded neck bolts with nuts and external tooth lock washers) not removable/accessible from the front i.e. without opening the door/front cover.  
SEC shall approve location and samples of danger and monogram plates prior the installation.

## 7 TESTING:

Panels shall be tested in accordance with the latest standards and as specified herein. All test results shall be provided for review and acceptance by SEC.

### 7.15 Type (Design) Test:

#### 7.15.7 Short Circuit Test:

The panel shall be capable of carrying the short circuit current (RMS, Symmetrical) for two (2) seconds as per Table - 1 above..

#### 7.15.8 Temperature Rise Test:

- a) Temperature rise test shall be conducted as per IEC 61439-1.
- b) Temperature rise test at any point shall not exceed 60°C relevant to the maximum ambient temperature as specified in SEC specification No. 01-SDMS-01 for LVDP with branch breakers.
- c) For Instruments inside the panel, the temperature rise shall not exceed the allowable temperature of the instruments.

7.15.9 Salt Spray Test and Tape (Scratch) Test shall be as given in SEC specification No. 01-SDMS-01.

7.15.10 Certified test reports of Design test performed on an identical unit shall be submitted to SEC for review and approval during bidding stage.

### 7.16 Routine Test:

All Routine Tests prescribed in the relevant IEC shall be performed on all units prior to delivery to SEC.



8 **INSPECTION:**

SEC may wish to witness tests or to visit factory during manufacture of any or all items covered in this specification. Accordingly the supplier shall give an advanced notice to SEC of the manufacturing and testing schedule.

9 **PACKING AND SHIPPING:**

Packing and shipping shall generally be as per SEC General Requirements No. 01-SDMS-01 including the following:

9.15 The panel shall be delivered ready for service.

9.16 Supplier shall contact Materials Department of SEC for additional packing, handling and shipment instructions as applicable.

9.17 Packing crates shall be marked with following :

- Manufacturer's name
- Country of origin
- SEC purchase order number
- SEC item number
- Gross weight in kilograms
- Handling instructions
- Final destination store
- Bus bar material : Aluminum

10 **GUARANTEE:**

The vendor shall guarantee the panel against all defects arising out of faulty design or workmanship or defective materials for a period of **five** years from the date of delivery or one year from the date of commissioning of the panel.

11 **SUBMITTALS:**

11.15 The vendor shall fill and submit one copy of the attached Technical Data Schedule with the quotation. In addition to Data Schedule, clause by clause compliance to this specification shall also be confirmed/ submitted.

11.16 Detailed dimensional drawings of the panel, showing all mounting arrangements, terminals, electrical clearances between phase and earth, hinges, cable clamps, locking arrangement and name plate shall be submitted.



11.17 Single line diagram shall be submitted.

11.18 The supplier shall provide literature describing field experience under similar service conditions to those in section 4.0. A reference's sale list shall be included.  
This shall detail the quantities sold, name and address of the user, number of years in service, in each case.

11.19 A comprehensive list of manufacturer's recommended spare parts with full details (item description, part No., manufacturer name, supplier name ...etc) shall be submitted separately

11.20 Catalogue that indicates the part No. of all the components inside the panel shall be submitted.

11.21 Detail drawing showing the installation of revenue metering CT as required in this specification.

**DATA SCHEDULE****Low Voltage Distribution Panel (Sheet 1 of 3)**

SEC Inquiry No. \_\_\_\_\_

Item No. \_\_\_\_\_

Clause	DESCRIPTION	SEC SPECIFIED VALUES	VENDOR PROPOSED VALUES
<b>4.0</b>	<b>DESIGN AND CONSTRUCTION REQUIREMENTS</b>		
<b>4.1</b>	<b>General</b>		
	Rated voltage	230/110V, ±5% 400/230V, ±5%	
	Symmetrical Short Circuit Rating for 2 seconds (RMS)	kA	
	Phase bus bar rating	(A)	
	Neutral bus bar rating	(A)	
4.1.8	Min. clearance between phases and phase to ground	25.4 mm	
<b>4.2</b>	<b>Incoming Transformer Connection</b>		
4.2.1	Removable copper links		
4.2.3	No. of incoming cables (for Stand-alone)	As per Table-1	
<b>4.3</b>	<b>Busbars</b>		
4.3.1	Material	Tinned Aluminum	
	Minimum thickness of tin plating	5% of nominal composition	
4.3.2	Size of phase bus bar		
4.3.3	Electrical joints (bolts, nuts, washers)	Plated as per SEC's Spec. No. 01-SDMS-01	
4.3.4	Insulating barrier to cover live parts	Yes	
4.3.5	Busbar color	Red/Yellow/Blue Black for neutral	
<b>4.4</b>	<b>Provision for generator connection</b>		
<b>4.5</b>	<b>Size of neutral bus bar</b>		
<b>4.6</b>	<b>Current Transformer :</b>		
	Class	0.5	
	Min. Burden	10 VA	
	Error co-efficient	< 5	
	Insultions class	Class E-120°C	
	Type and make		

**DATA SCHEDULE****Low Voltage Distribution Panel (Sheet 2 of 3)**

SEC Inquiry No. \_\_\_\_\_

Item No. \_\_\_\_\_

Clause	DESCRIPTION	SEC SPECIFIED VALUES	VENDOR PROPOSED VALUES
4.7	<b>Ammeters:</b> Type and make		
	Size	96mm x 96mm	
	<b>Voltmeters:</b> Type and make		
	Size	96mm x 96mm	
4.8	<b>KWH-Meter Wiring Provision</b>		
4.9	<b>Outgoing MCCB's:</b> Type, Model & Make Rated current Dimensions(L x W x D) mm No. of supplied MCCBs No. of provisions for fixing MCCB's	400 A	
4.10	<b>Grounding :</b> Two terminals of M12 stud Copper braid for hinged parts	Yes 35mm <sup>2</sup>	
4.11	<b>Internal Lighting</b>	100W	
4.12	<b>Auxiliary Supply:</b>		
4.13	<b>L.V. Cable Supports</b>		
4.14	<b>Labels</b>		
4.15	<b>Enclosure:</b> Material Thickness of sheet Degree of protection Type of gasket Locking arrangement  Finishing color	Steel sheet/Aluzinc 3mm/2mm IP53 /IP41 Pressure fit clause 4.17.4 As per RAL 7035	
4.16	<b>Dimensions L x W x H (mm) (for Stand-alone L.V. panel)</b>		
6.0	<b>MONOGRAM &amp; DANGER PLATES</b>	Yes	



**DATA SCHEDULE****Low Voltage Distribution Panel (Sheet 3 of 3)**

SEC Inquiry No. \_\_\_\_\_ Item No. \_\_\_\_\_

- A. Additional technical information or features specified by SEC:
- B. Additional supplementary data or features proposed by vendor/supplier:
- C. Other particulars to be filled up by vendor/supplier:  
(use separate sheet if needed)


Address	Manufacturer	Vendor/Supplier
Name of Company		
Location and Office Address		
Authorized Name and Signature		
Date		
Official seal / stamp		




SEC DISTRIBUTION MATERIALS SPECIFICATION

31-SDMS-07 REV. 01


DATE: MAY 2017G

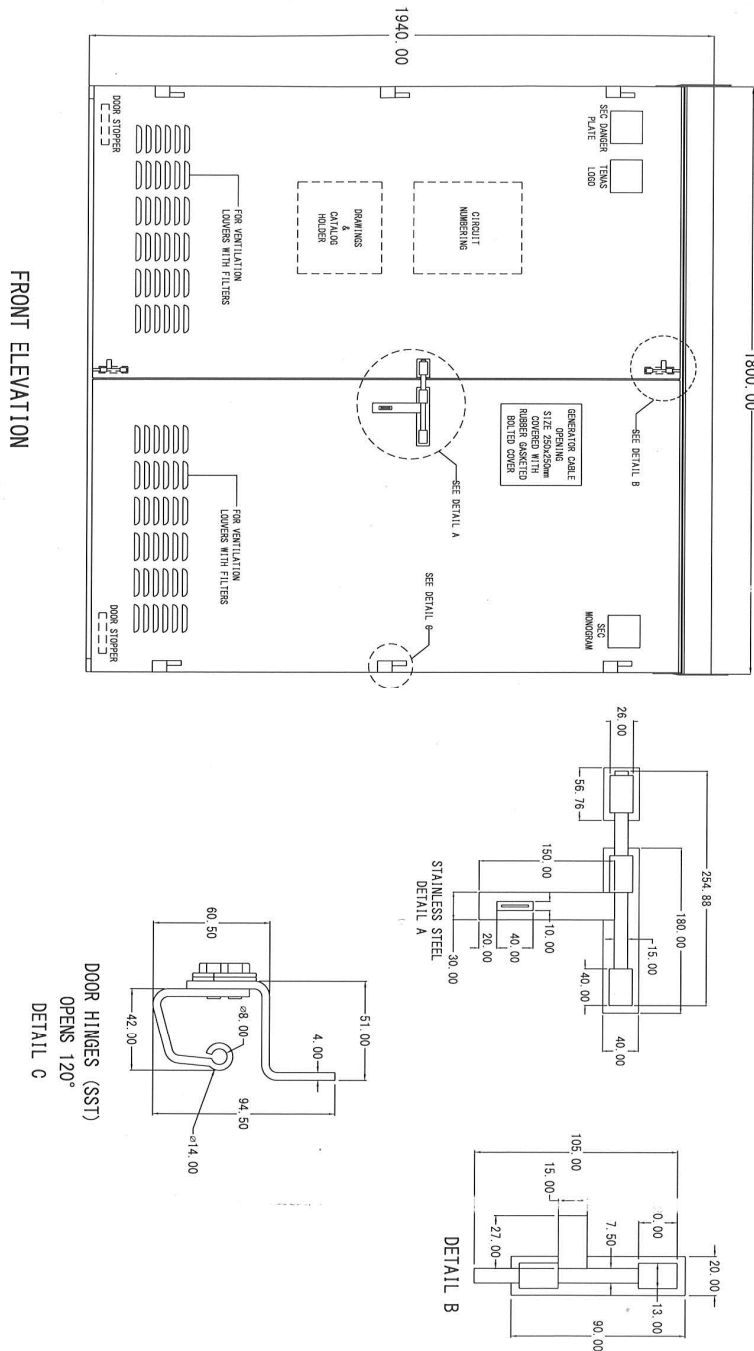


**Figure 1: Front View Of Door**

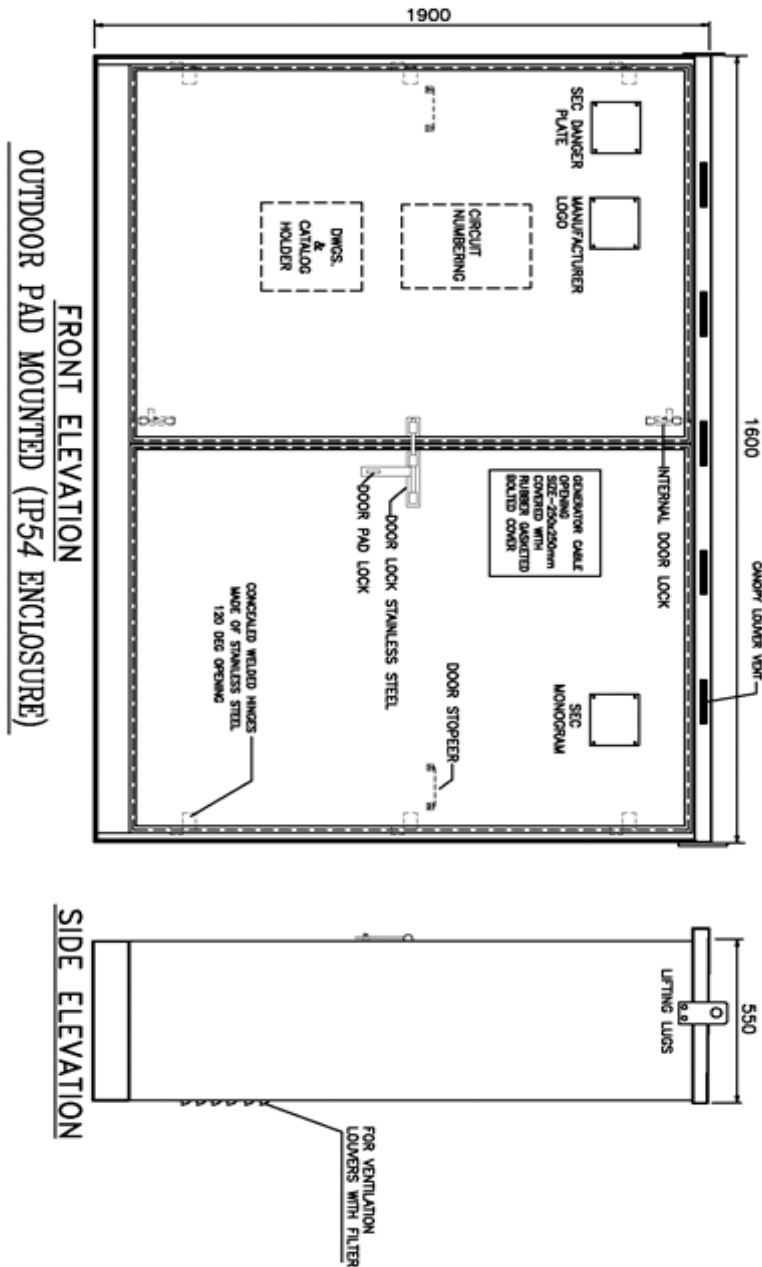

**Figure 2: Door Details-Side Elevation**

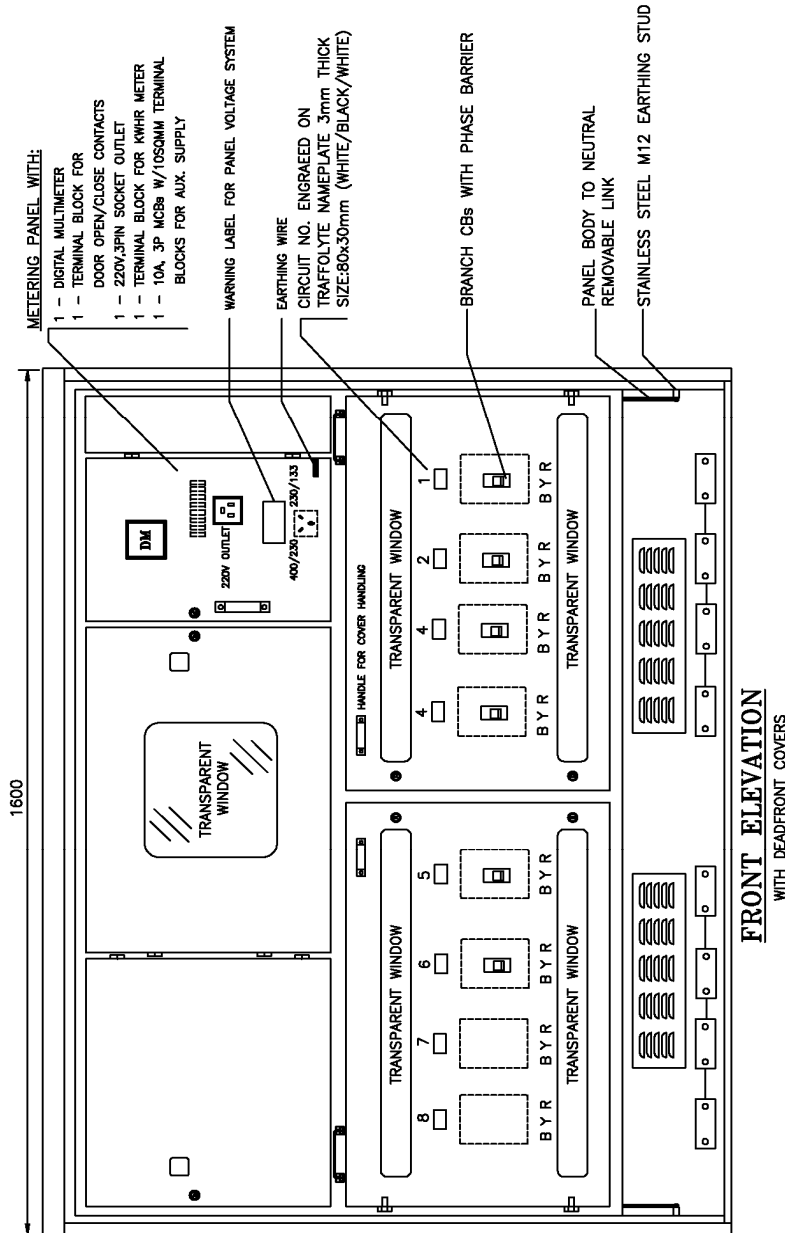


**Figure 3: Indoor LVPD**

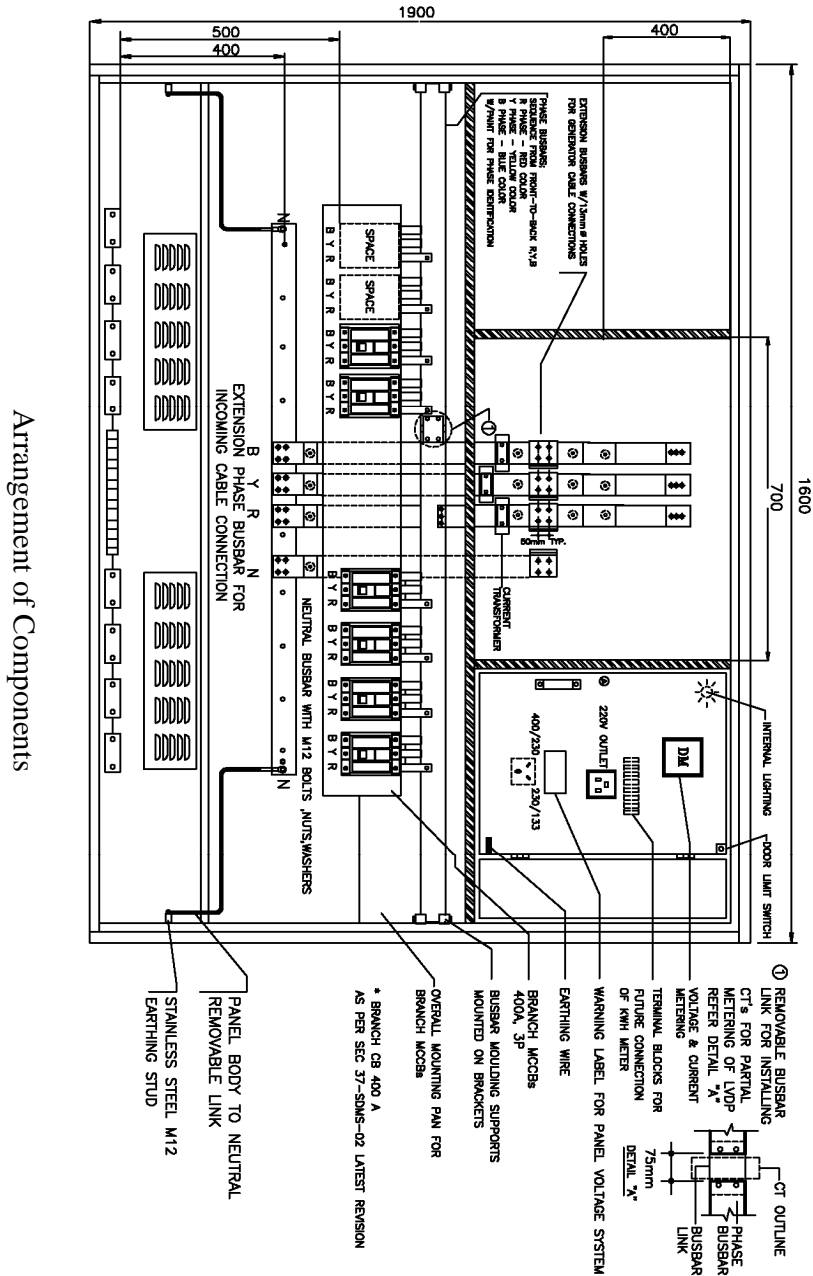


Arrangement of Components

Figure 4: Panel Internal Layout

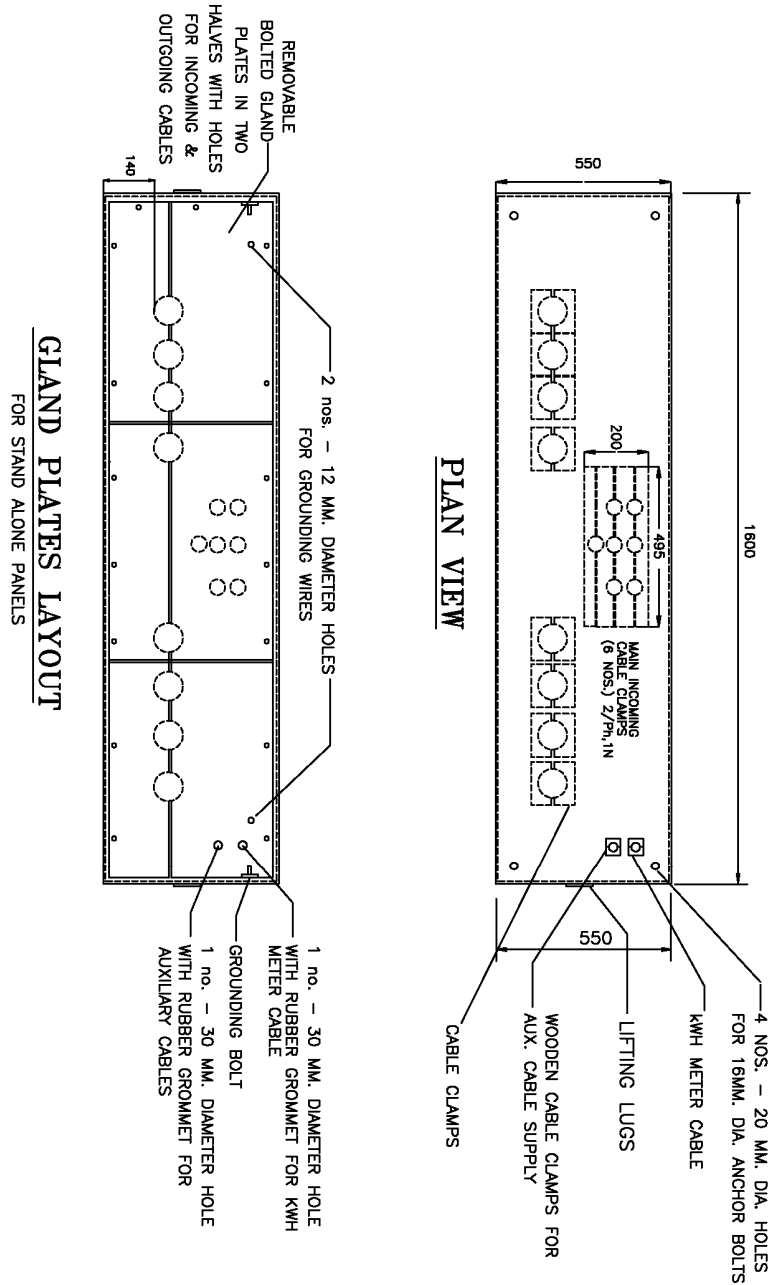


**Figure 5: Plan View Of Gland Plate**

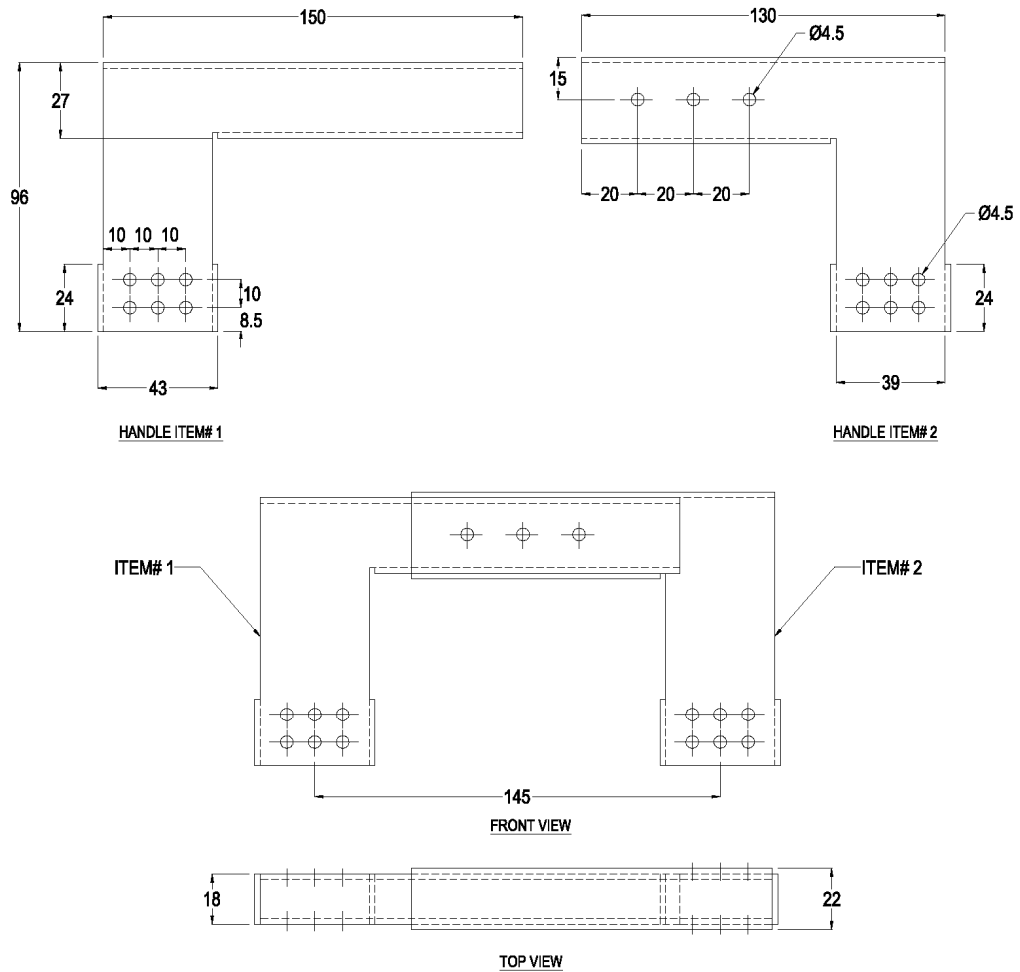


MATERIAL:  
2mm GALVANIZED STEEL SHEETS


**Figure 6: Handle For Two Interconnected Breakers**



WOODEN CABLE CLAMPS FOR AUXILIARY SUPPLY CABLES

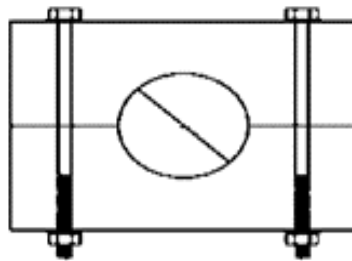

WOODEN CABLE SUPPORTS FOR INCOMING CABLES

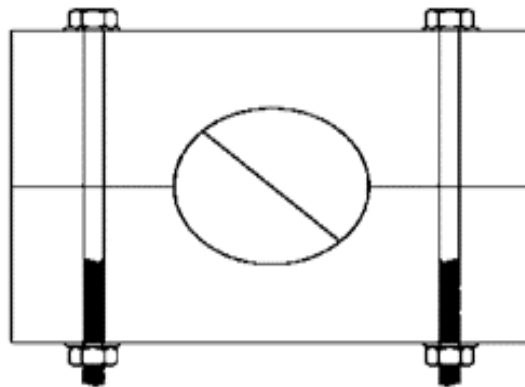

WOODEN CABLE SUPPORTS FOR OUTGOING CABLES

Dimensions as per Cable Diameters

**Figure 7: Wooden Cable Clamps**





CIRCUIT NUMBER	DESCRIPTION
1	
2	
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	

**NOTE**

TABLE SIZE SHALL BE PROPORTIONAL TO THE INSIDE OF THE LEFT SIDE DOOR OF THE PANEL

**Figure 8: Circuit Label**